

# Town of Mt. Airy 2019 Annual Water Quality Report WISD#1370005

## **Is my water safe?**

We are pleased to present this year's Annual Water Quality Report (Consumer Confidence Report) as required by the Safe Drinking Water Act (SDWA). This report is designed to provide details about where your water comes from, what it contains, and how it compares to standards set by regulatory agencies. This report is a snapshot of last year's water quality. We are committed to providing you with information because informed customers are our best allies.

## **Do I need to take special precautions?**

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Water Drinking Hotline (800-426-4791).

## **Where does my water come from?**

The Town of Mt. Airy pumps drinking water from 5 ground water wells located within the city limits. The water is treated at each location before being pumped for distribution lines and storage tanks. The city purchases water from the City of Demorest. The town also maintains a connection with the City of Cornelia in case of an emergency.

## **Source water assessment and its availability**

Source water Assessment information is available upon request at City Hall.

## **Why are there contaminants in my drinking water?**

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791). The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity: microbial contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife; inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban stormwater runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming; pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses; organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems; and radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

## **How can I get involved?**

The Town Council holds meetings on the first Monday of each month at the Town Hall located at 1231 Dicks Hill Pkwy. unless otherwise scheduled. to verify the location, date, time of any Town Council meeting please call (706)778-6990.

Questions or comments concerning the water system can be submitted to the Water Department P.O. Box 257 1231  
Dicks Hill Pkwy Mt. Airy Ga.  
30563

## Water Conservation Tips

Did you know that the average U.S. household uses approximately 400 gallons of water per day or 100 gallons per person per day? Luckily, there are many low-cost and no-cost ways to conserve water. Small changes can make a big difference - try one today and soon it will become second nature.

- Take short showers - a 5 minute shower uses 4 to 5 gallons of water compared to up to 50 gallons for a bath.
- Shut off water while brushing your teeth, washing your hair and shaving and save up to 500 gallons a month.
- Use a water-efficient showerhead. They're inexpensive, easy to install, and can save you up to 750 gallons a month.
- Run your clothes washer and dishwasher only when they are full. You can save up to 1,000 gallons a month.
- Water plants only when necessary.
- Fix leaky toilets and faucets. Faucet washers are inexpensive and take only a few minutes to replace. To check your toilet for a leak, place a few drops of food coloring in the tank and wait. If it seeps into the toilet bowl without flushing, you have a leak. Fixing it or replacing it with a new, more efficient model can save up to 1,000 gallons a month.
- Adjust sprinklers so only your lawn is watered. Apply water only as fast as the soil can absorb it and during the cooler parts of the day to reduce evaporation.
- Teach your kids about water conservation to ensure a future generation that uses water wisely. Make it a family effort to reduce next month's water bill!
- Visit [www.epa.gov/watersense](http://www.epa.gov/watersense) for more information.

## Additional Information for Lead

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Town of Mt. Airy is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

---

## Water Quality Data Table

In order to ensure that tap water is safe to drink, EPA prescribes regulations which limit the amount of contaminants in water provided by public water systems. The table below lists all of the drinking water contaminants that we detected during the calendar year of this report. Although many more contaminants were tested, only those substances listed below were found in your water. All sources of drinking water contain some naturally occurring contaminants. At low levels, these substances are generally not harmful in our drinking water. Removing all contaminants would be extremely expensive, and in most cases, would not provide increased protection of public health. A few naturally occurring minerals may actually improve the taste of drinking water and have nutritional value at low levels. Unless otherwise noted, the data presented in this table is from testing done in the calendar year of the report. The EPA or the State requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not vary significantly from year to year, or the system is not considered vulnerable to this type of contamination. As such, some of our data, though representative, may be more than one year

old. In this table you will find terms and abbreviations that might not be familiar to you. To help you better understand these terms, we have provided the definitions below the table.

Contaminants	MCLG or MRDLG	MCL, TT, or MRDL	Detect In Your Water	Range		Sample Date	Violation	Typical Source
				Low	High			
<b>Disinfectants &amp; Disinfection By-Products</b>								
(There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants)								
Chlorine (as Cl <sub>2</sub> ) (ppm)	4	4	1.6	.3	1.6	2019	No	Water additive used to control microbes
<b>Inorganic Contaminants</b>								
Fluoride (ppm)	4	4	.21	NA	.21	2018	No	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories
Nitrate [measured as Nitrogen] (ppm)	10	10	.52	NA	.52	2019	No	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
<b>Microbiological Contaminants</b>								
Turbidity (NTU)	NA	0.3	100	NA	NA	2019	No	Soil runoff (Monitored by City of Demorest)
100% of the samples were below the TT value of .3. A value less than 95% constitutes a TT violation. The highest single measurement was . Any measurement in excess of 1 is a violation unless otherwise approved by the state.								
Contaminants	MCLG	AL	Your Water	Sample Date	# Samples Exceeding AL	Exceeds AL	Typical Source	
<b>Inorganic Contaminants</b>								
Copper - action level at consumer taps (ppm)	1.3	1.3	.51	2019	0	No	Corrosion of household plumbing systems; Erosion of natural deposits	
Lead - action level at consumer taps (ppb)	0	15	0	2019	0	No	Corrosion of household plumbing systems; Erosion of natural deposits	

Unit Descriptions	
Term	Definition
ppm	ppm: parts per million, or milligrams per liter (mg/L)
ppb	ppb: parts per billion, or micrograms per liter (µg/L)
NTU	NTU: Nephelometric Turbidity Units. Turbidity is a measure of the cloudiness of the water. We monitor it because it is a good indicator of the effectiveness of our filtration system.
NA	NA: not applicable
ND	ND: Not detected
NR	NR: Monitoring not required, but recommended.

<b>Important Drinking Water Definitions</b>	
<b>Term</b>	<b>Definition</b>
MCLG	MCLG: Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.
MCL	MCL: Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.
TT	TT: Treatment Technique: A required process intended to reduce the level of a contaminant in drinking water.
AL	AL: Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.
Variances and Exemptions	Variances and Exemptions: State or EPA permission not to meet an MCL or a treatment technique under certain conditions.
MRDLG	MRDLG: Maximum residual disinfection level goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
MRDL	MRDL: Maximum residual disinfectant level. The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
MNR	MNR: Monitored Not Regulated
MPL	MPL: State Assigned Maximum Permissible Level

**For more information please contact:**

Contact Name: James Kimsey  
Address: 1231 Dicks hill Pkwy  
Mount Airy, GA 30563  
Phone: 7067688589

# THE CITY OF DEMOREST

## WATER QUALITY DATA 2019

Water System ID# 1370004

### Where does my water come from?

The sources of drinking water (tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

The City of Demorest is a purchased water system (PWS) and provides water to residents inside the city limits of Demorest and many residents in Habersham County. These are the only customers to whom water is sold directly. Our Georgia Water System Identification is 1370004. The source of our drinking water is the Baldwin Water Treatment Plant. The Baldwin Water Treatment Plant is a surface water treatment plants.(SWTP).. It is located at 288 Coldwater Dr. just off of Highway 105 North. The source of their drinking water is the Chattahoochee River. The City of Demorest also supplements its water system with two permitted wells. One located at 571 Mize Rd. Demorest, Ga., and the other at 415 Crystal Way, Alto, Ga.

### Why are there contaminants in my drinking water?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791). The sources of drinking water (both tap and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Microbial contaminants, such as viruses and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife. Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban storm water runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming. Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses. Organic Chemical Contaminants, including synthetic and volatile organic chemicals which are by-products of industrial processes and petroleum production and can also, come from gas stations, urban storm water runoff, and septic systems. Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water must provide the same protection for public health.

### Lead in Drinking Water

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City of Demorest is a purchased water system and is responsible for delivering safe and reliable drinking water, but cannot control the variety of components and materials used in plumbing. If you are concerned about lead in your water you may wish to have it tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline at <http://www.epa.gov/safewater/lead>

### Do I need to take special precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).

### How can I get involved?

All water quality and source assessment reports are available at the Demorest City Hall. Any questions can be directed to Brian Popham at 706-778-4202. The City of Demorest Council meets on the first Tuesday of each month at 6:30 p.m.

The City of Demorest Water Dept. collected 240 coliform bacteria samples in 2019 all of which were negative for coliform bacteria. The City of Demorest and its Water Dept. employees are constantly working diligently to provide safe and reliable drinking water to the all of its water customers.

### Water Quality Data Table

MCL-maximum contaminant level

PPM- parts per million


PPB- parts per billion


MCLG-maximum contaminant level goal

MRDL-maximum residual disinfection level

MRDLG- maximum residual disinfection level goal

N/A - Not applicable

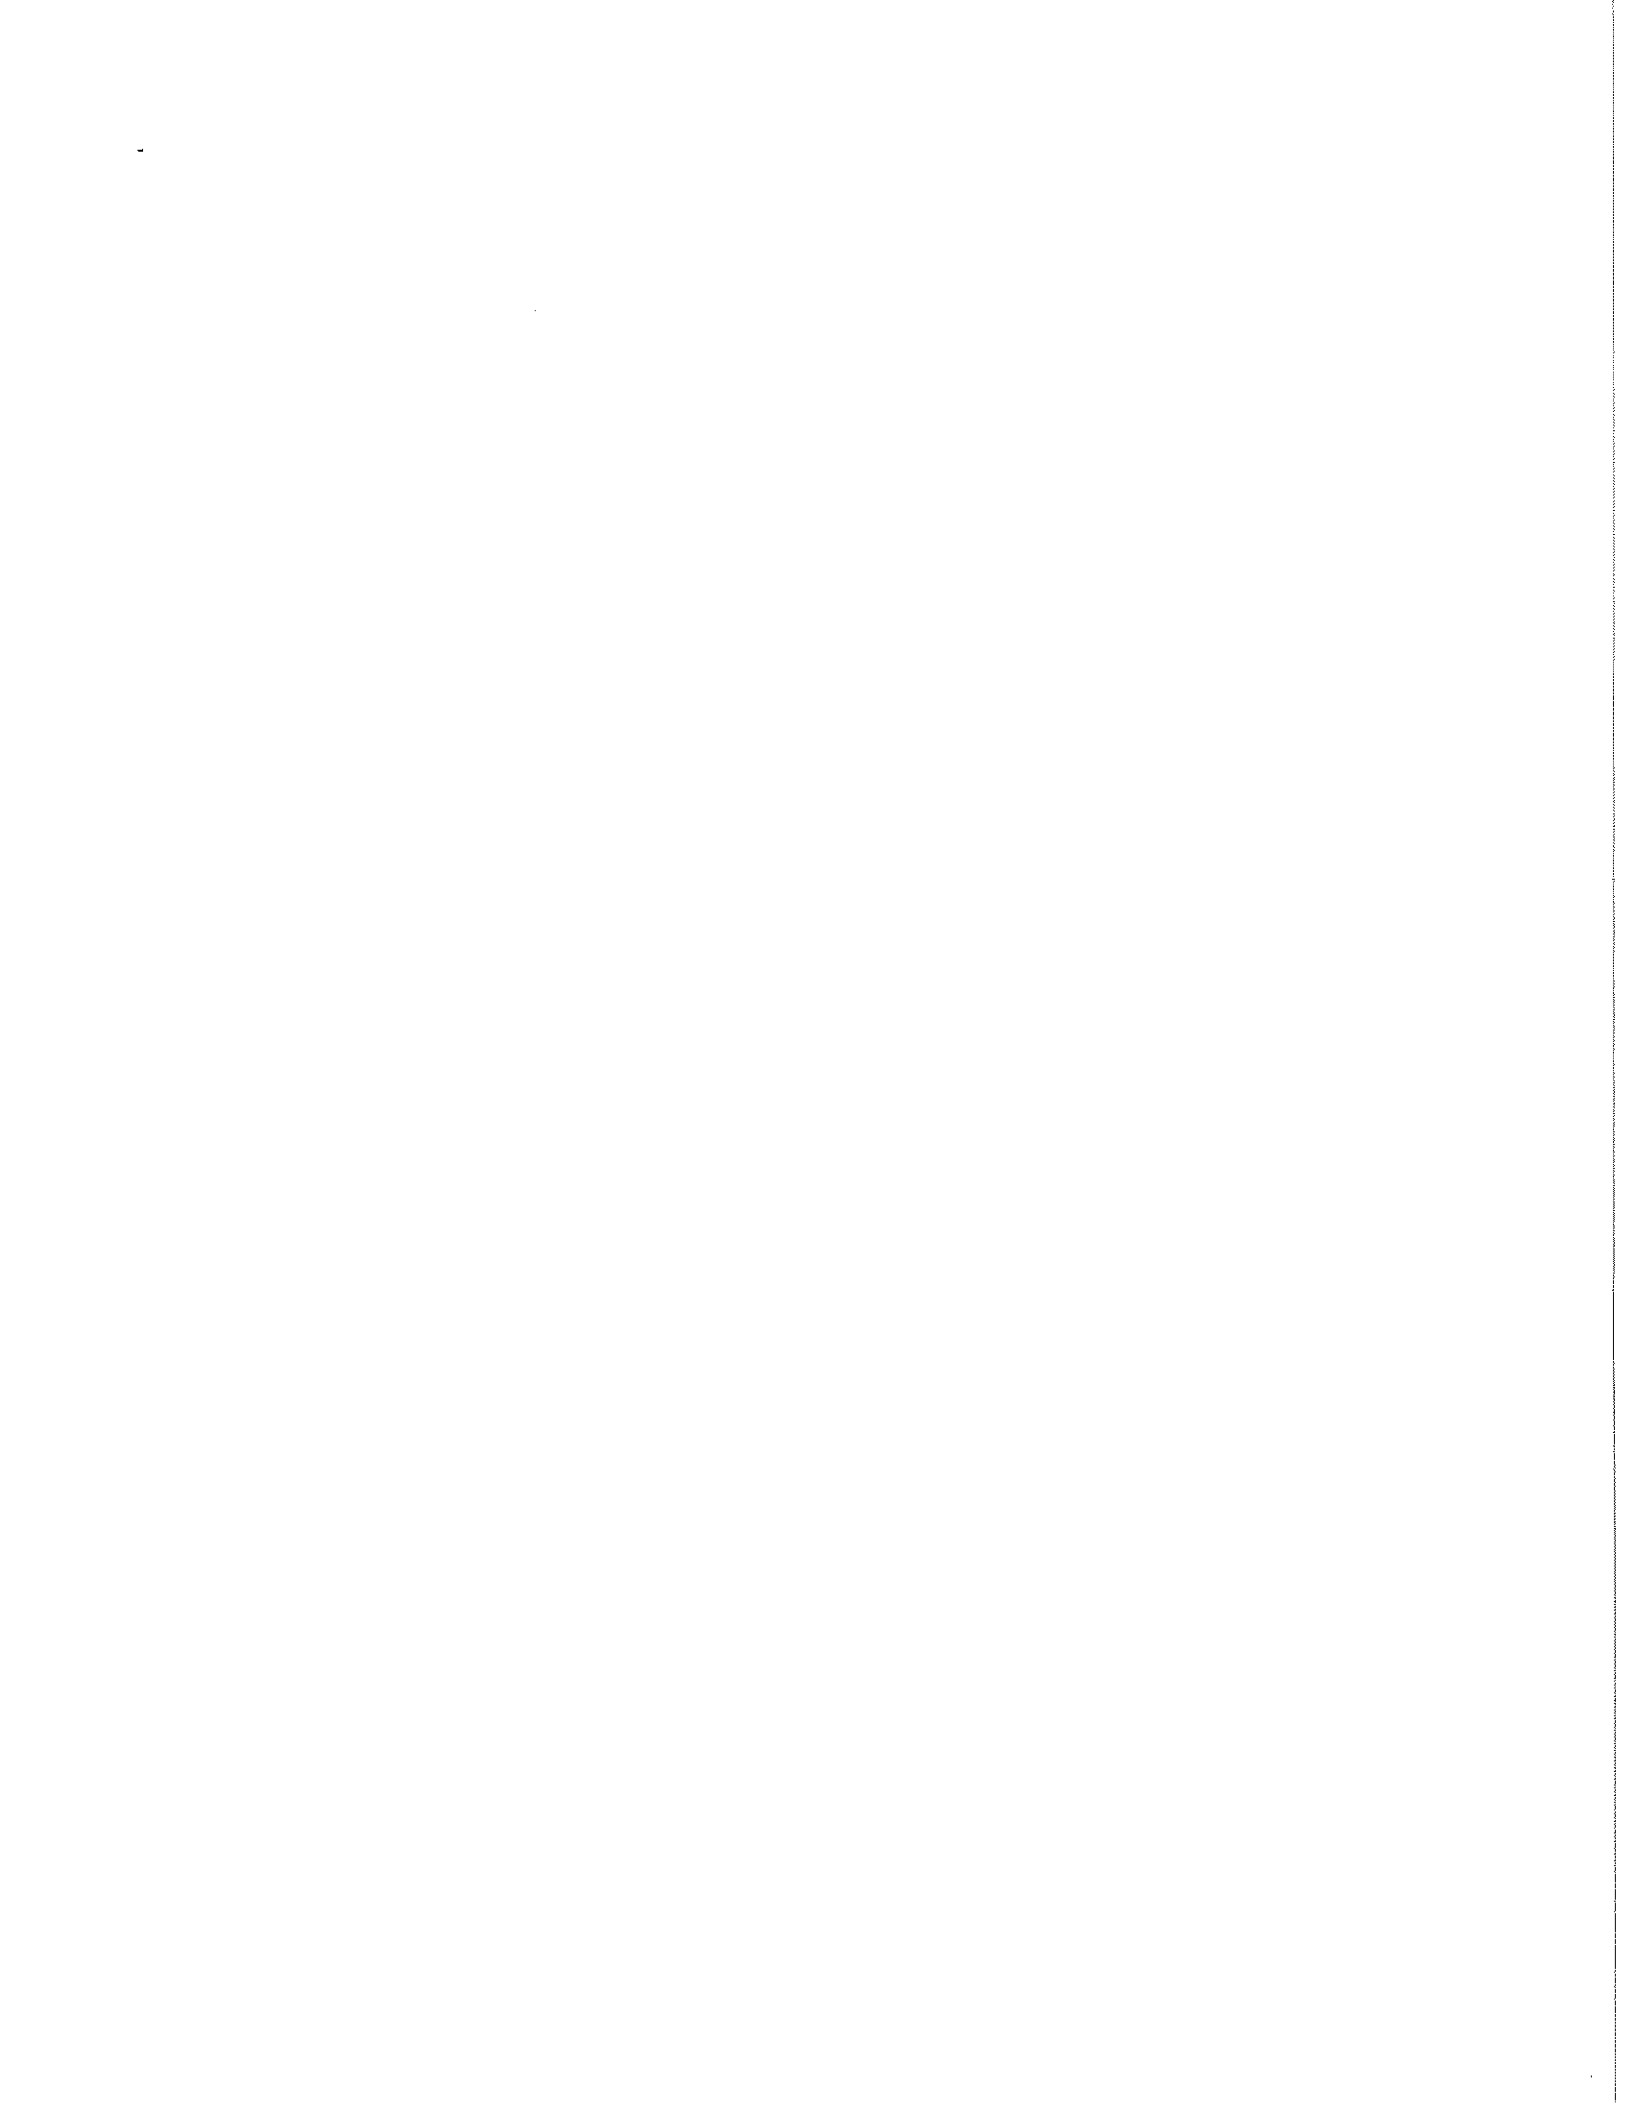



	MCLG	MCL	Amount Detected	Violation	Probable Source
Copper (ppb)	1300	1300 <sup>1</sup>	160	No	Corrosion of household plumbing systems
Fluoride (ppm)	4.0	4.0	.84	No	Additive that promotes strong teeth
Lead (ppb)	0	15 <sup>1</sup>	0	No	Corrosion of household plumbing systems
Total Coliform (bacteria)	0%	5	0%	No	Coliform bacteria are naturally present in the environment and are used as an indicator that other potentially harmful bacteria may be present
Turbidity	N/A	TT=1.0 NTU % of samples<.30 NTU	100%	NO	Soil runoff and erosion
<b><u>City of Demorest</u></b>	<b>MCLG</b>	<b>MCL</b>	<b>Amt. Detected</b>	<b>Violation</b>	<b>Probable Source</b>
<b><u>Volatile Contaminants</u></b>					
TTHM's	N/A	80	9.32 to 10.5	No	By-product of Disinfection
HAA5's	N/A	60	4.29 to 5.53	No	By-Product of Disinfection
Nitrates	N/A	10.0	Not Detected	No	Run-off from fertilizers, leaching from septic tanks, sewage, erosion of natural deposits.
Chlorination	4.0	4.0	0.20 to 2.0	No	Water Disinfectant
Fluoride	4.0	4.0	0.33 to 0.75	No	Additive to strengthen teeth




- The University of Georgia completed a Source Water Assessment in October 2003. That report is available for review at Toccoa City Hall-Water/Wastewater Utility.
- Total tests performed by The City of Toccoa in 2018:56,245. Total gallons of water treated in 2018: 1.28 billion gals.